


Lighting Contactor Control Scheme A

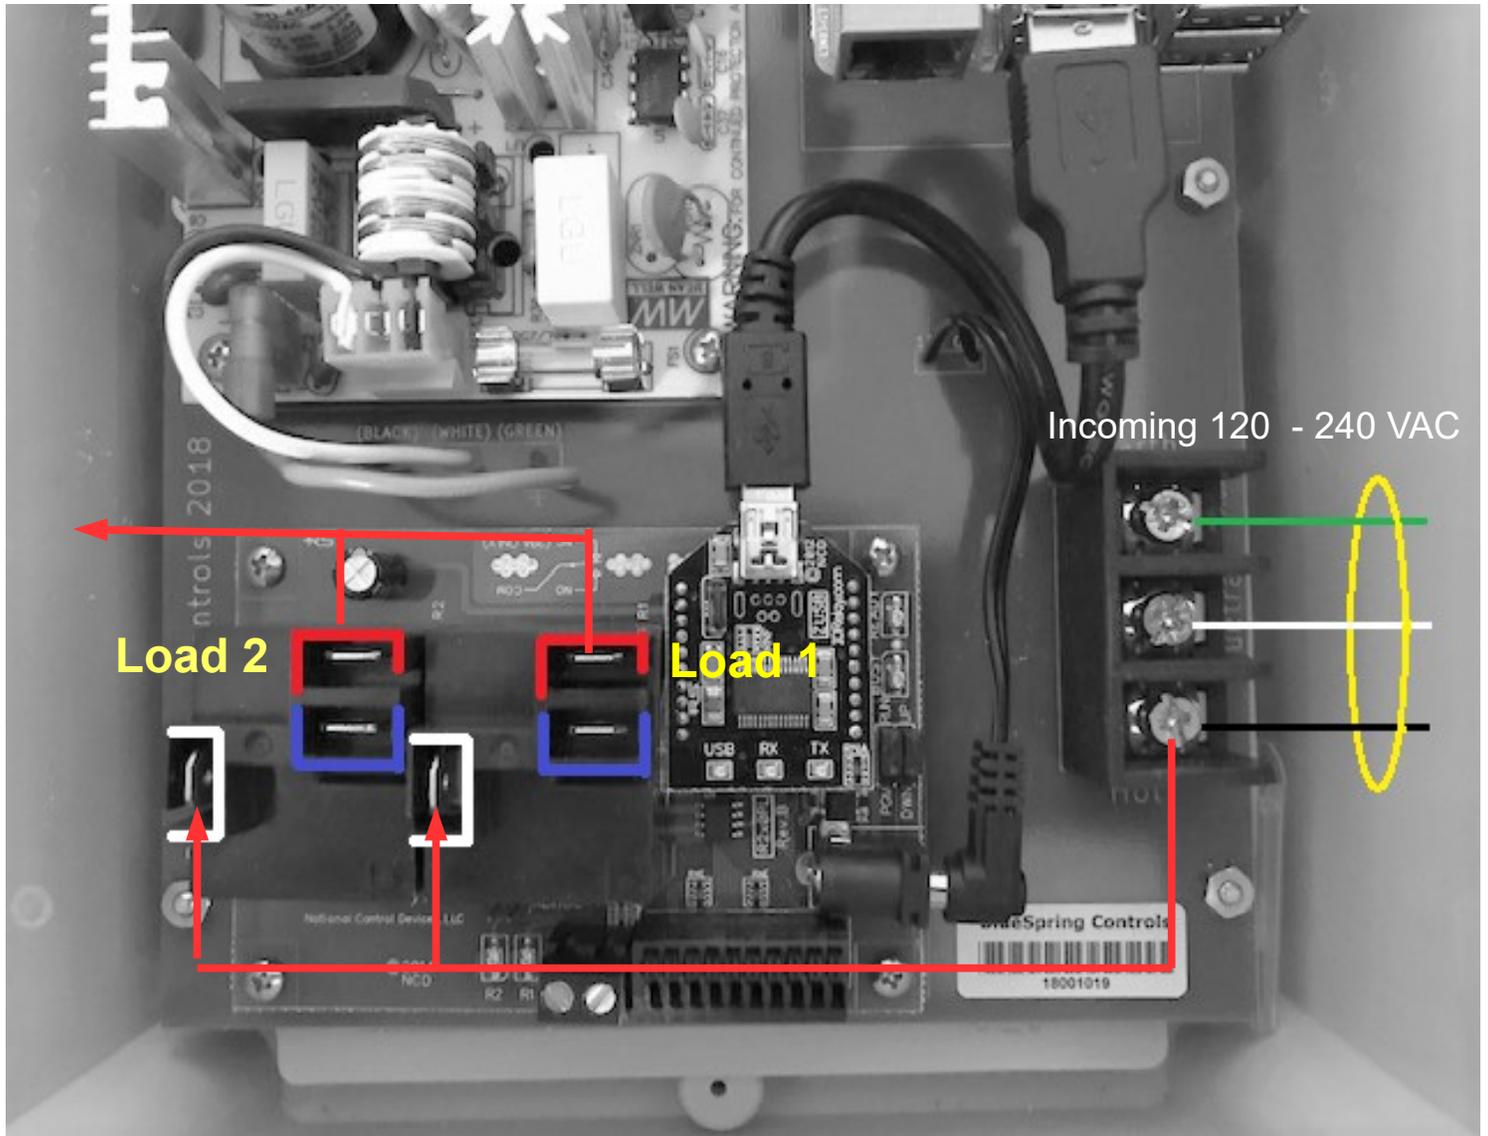

Wire to N.C. terminals (RED)

If lighting contactors coils are the **same voltage** as voltage powering the M215 or M415, then a jump from Line input HOT to the Common (white) terminal of Load 1 and 2 is permissible. This will supply the switched power to lighting contactors.

M Series relay ratings:
N.O. 20A N.C. 10A @ 240 VAC