


Lighting Contactor Control Scheme B

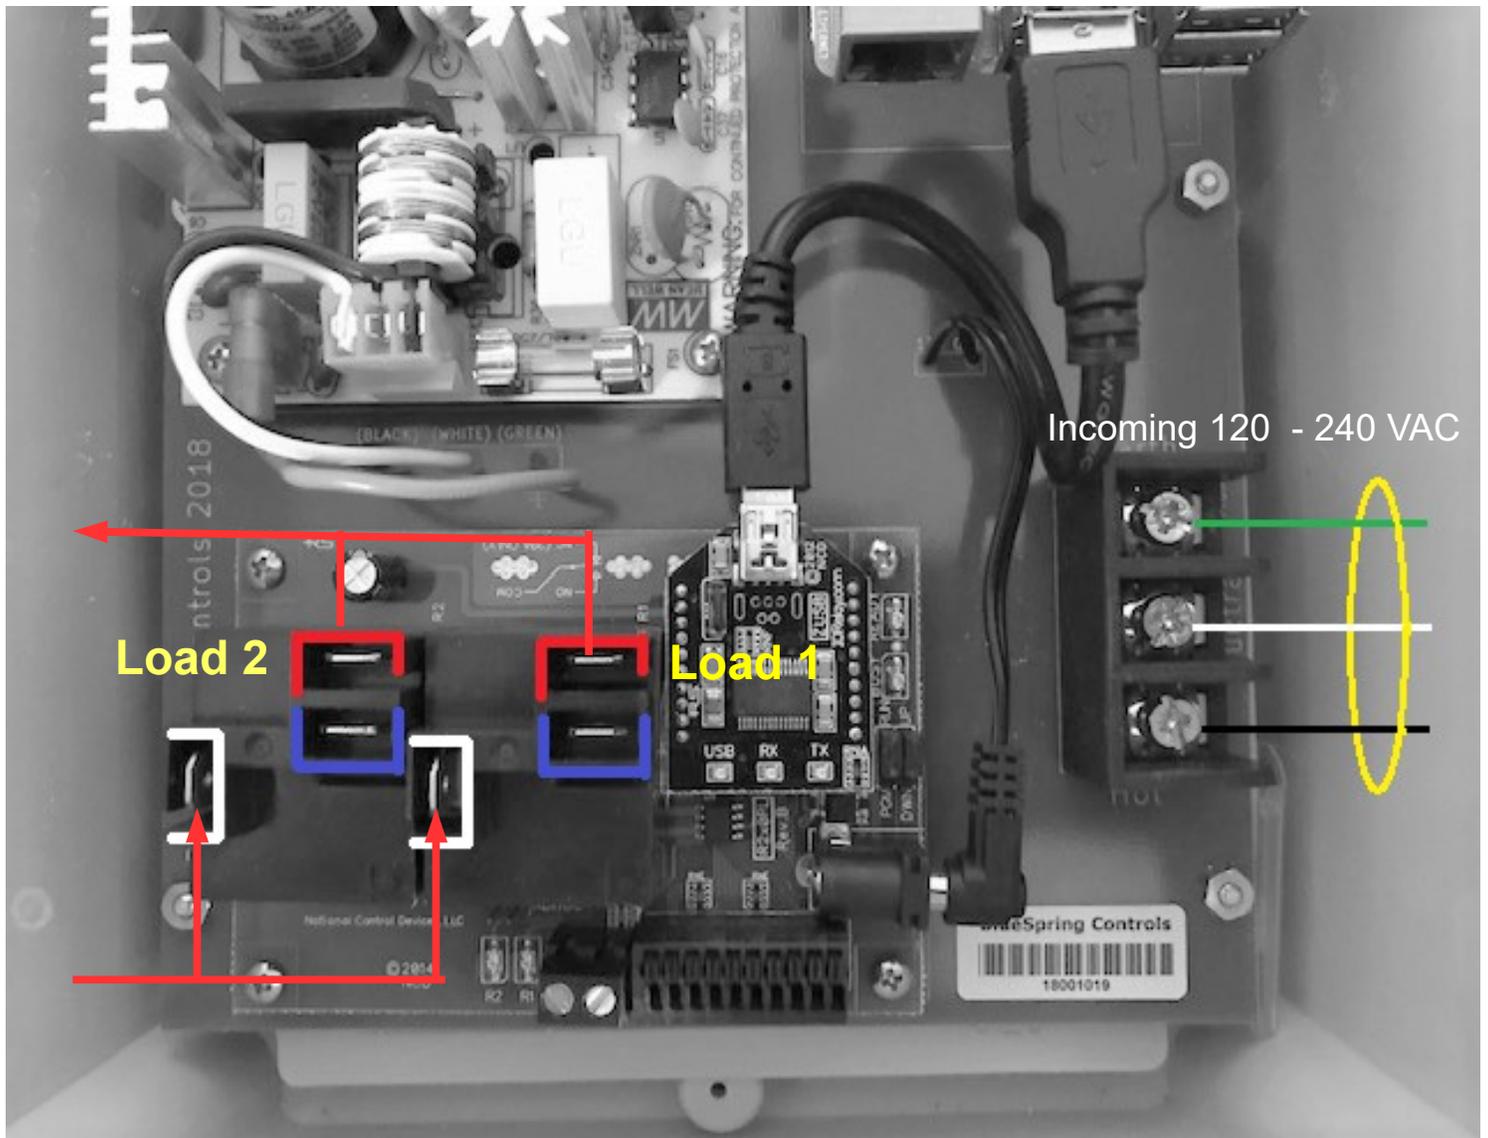

Wire to N.C. terminals (RED)

If lighting contactors coils are a **different voltage** as voltage powering the M215 or M415, then an independent voltage source matching the lighting coils must be provided. This will provide the switching action for the coils.

M Series relay ratings:
N.O. 20A N.C. 10A @ 240 VAC